

# TRIPSAVER<sup>®</sup> II CUTOUT-MOUNTED RECLOSER



Save money and increase reliability.

Reduce momentary outages and truck rolls with S&C's self-powered, electronically controlled single-phase recloser.

## CONTENTS

Utilities need a better option for their fault-protection strategy.	1
Fault-protection strategies	2
Application	3
The TripSaver II recloser's operating sequence	3
How the TripSaver II recloser works for a temporary fault	4
How the TripSaver II recloser works for a permanent fault	4
The TripSaver II recloser's features are:	6
TripSaver <sup>®</sup> II Communications via Gateway	8
TripSaver <sup>®</sup> II Service Center Configuration Software	9
Service Center Configuration Kit	9

A better solution for overhead lateral circuit protection at 15 kV and 25 kV

## Utilities need a better option for their fault-protection strategy.

More than 80% of overhead distribution faults are temporary. A utility's lateral-protection strategy could either be causing more momentary outages or more truck rolls.

A TRUCK ROLL CAN EXCEED  
**\$1000**



With all the laterals on a utility's system, truck-roll costs can add up to millions of dollars every year.

Over the years, utilities have dealt with lateral protection a couple of ways.



# Fault-protection strategies

Some utilities use a “fuse-blowing” philosophy. The substation feeder breaker is properly coordinated with the lateral fuse so the fuse, not the breaker, will clear any downstream fault within its rating. Customers on the lateral experience permanent service interruption—even for a temporary fault, as shown in Figure 1. And the utility must deal with the high cost of service calls to replace lateral fuses.


Other utilities use a “fuse-saving” philosophy. The first trip of the substation feeder breaker is intentionally coordinated so the breaker operates faster than the lateral fuse to clear a fault downstream of the lateral fuse. The second trip of the breaker is slower, so if the fault is still present, the lateral fuse will operate to clear it. All customers on the feeder experience a momentary interruption for all faults, as shown in Figure 2.

S&C’s TripSaver II Cutout-Mounted Recloser combine the best of fuse-saving and fuse-blowing philosophies and improve reliability.


TripSaver II reclosers keep the power on and avoid truck rolls. A lateral-reclosing strategy ensures temporary faults do not result in a permanent interruption and other laterals on the feeder are not “blinked.”

Power can be restored automatically for temporary faults, avoiding a permanent outage or the need for a truck roll. Utilities will see immediate improvement in the frequency of permanent outages on their system.

**FIGURE 1.** “Fuse-blowing” philosophy

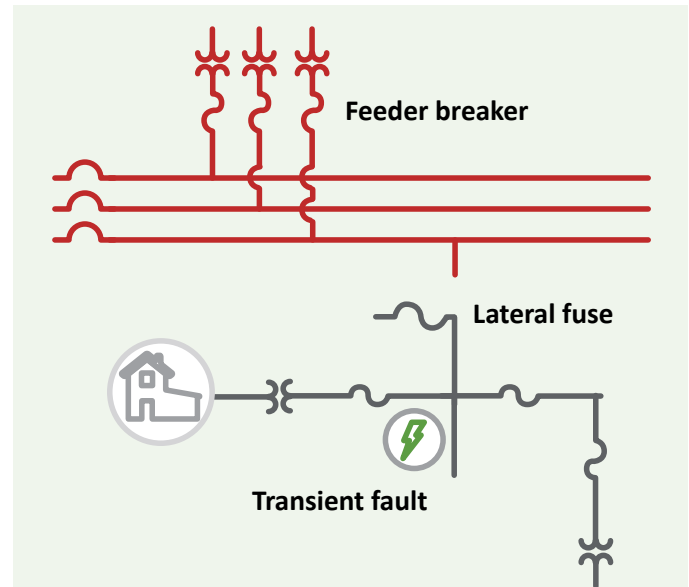


**FIGURE 2.** “Fuse-saving” philosophy

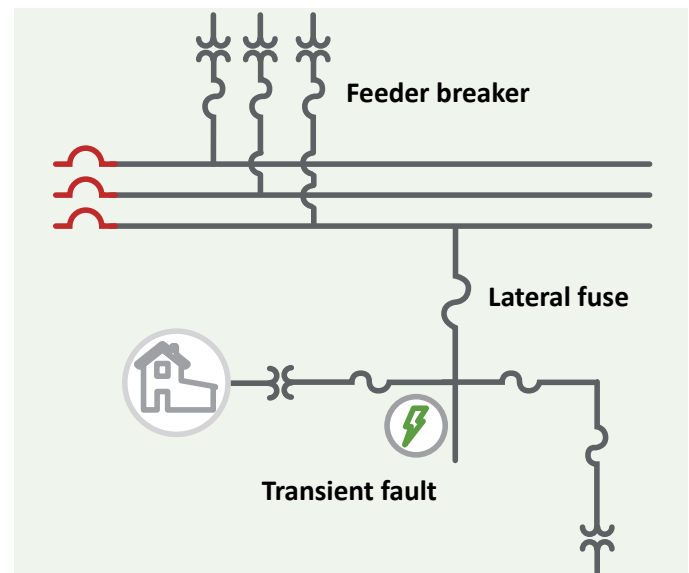

Another benefit of a lateral-reclosing strategy is it moves the reclosing closer to the problem, allowing only the faulted lateral to experience a blink. See Figure 3.

**FIGURE 3.** The TripSaver II recloser opens

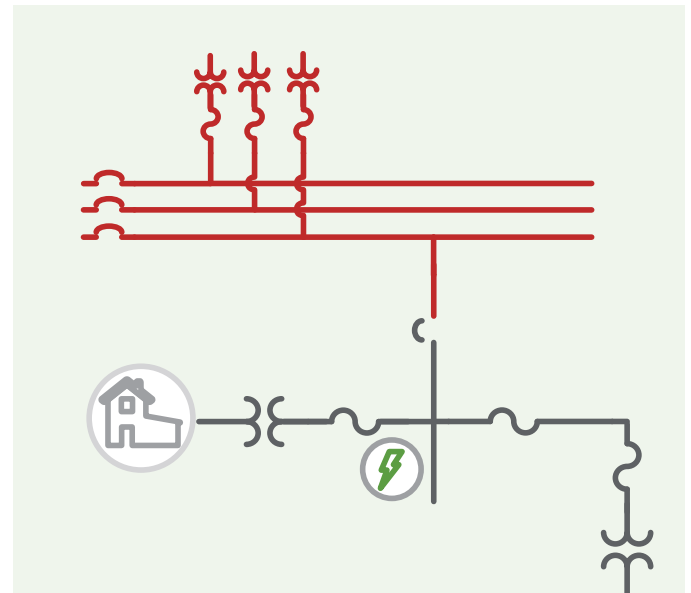

## Application

### THE TRIPSAVER II RECLOSER'S OPERATING SEQUENCE

The TripSaver II Cutout-Mounted Recloser supports up to three reclosing operations (four tripping operations in total) before it drops open. A variety of time-current characteristic (TCC) curves are available. The duration of the open interval between tripping operations is user-configurable. It has a range from 0.5 seconds to 5 seconds.

An option with an extended open interval of up to 30 seconds is also available.

The vacuum interrupter resets 2 seconds after the TripSaver II recloser drops open. The operator can then manually close the TripSaver II recloser back in to the mounting after the repair has been made.

In instances when a temporary fault clears before the TripSaver II recloser reaches the end of its operating sequence, the recloser will revert to its first TCC curve after its sequence reset timer expires. The sequence reset time is also user-configurable, and it has a range from 0.5 seconds to 1,000 seconds.

# Application

## HOW THE TRIPSAVER II RECLOSER WORKS FOR A TEMPORARY FAULT


Consider a temporary fault downstream of the TripSaver II Cutout-Mounted Recloser. Using its fast TCC curve, the TripSaver II recloser opens, as shown in Figure 3 on page 3. Only customers served from the lateral downstream of the TripSaver II recloser experience a momentary interruption.

After the open interval, the TripSaver II recloser recloses, restoring power to customers served from the lateral downstream. Because the fault was temporary and cleared, additional tripping operations aren't needed. The TripSaver II recloser reverts to its first TCC curve after the sequence reset time.


## HOW THE TRIPSAVER II RECLOSER WORKS FOR A PERMANENT FAULT

Consider a permanent fault downstream of the TripSaver II recloser. Because the fault is persistent, the TripSaver II Cutout-Mounted Recloser performs additional tripping operations per the specified TCC curves. For utilities using a “fuse-saving” philosophy, the TripSaver II recloser drops open at the end of its operating sequence in the same manner as a standard fuse cutout—providing visual indication the faulted lateral has been isolated, as shown in Figure 4. The vacuum interrupter resets 2 seconds after the TripSaver II recloser drops open. The recloser may then be manually closed back in to the mounting by the operator when the cause of the fault has been repaired.

FIGURE 4. The TripSaver II recloser drops open

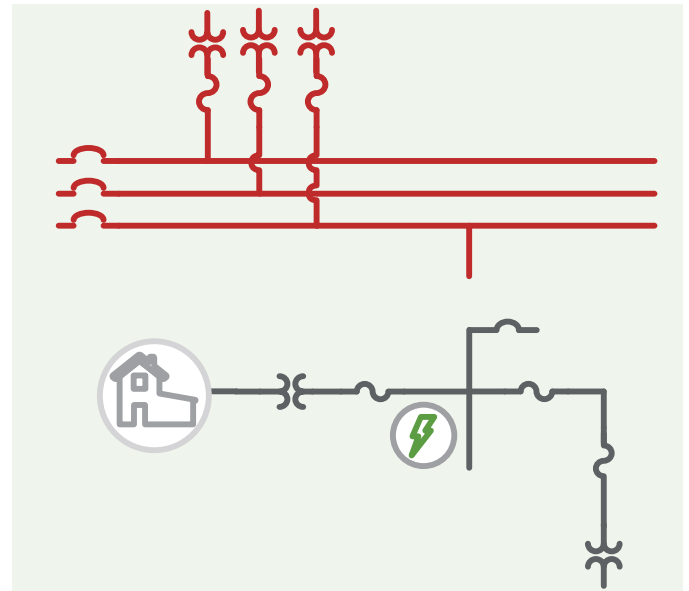

- A** Parallel-groove connector—Fabricated of tin-plated cast red brass (For ease of connection, the recloser accommodates two conductors of different sizes.)
- B** Type XS Fuse Cutout Mounting—With its birdproof design and composite polymer silicone or porcelain insulators, Type XS Fuse Cutout Mountings provide better characteristics than ANSI distribution cutout standards. TripSaver II reclosers can be installed in new or existing production (“-R10” or “-R11”) mountings.
- C** Bumper and retainer—Unique to TripSaver II reclosers, this spring-loaded retainer and bumper dampen impact on closing, reducing the possibility of bounce-back.
- D** Attachment hooks—These allow the TripSaver II recloser to be manually opened using Loadbuster®—The S&C Loadbreak Tool.
- E** Vacuum fault interrupter—Located in the upper housing, it quietly contains and interrupts the fault without exhaust or sparking.
- F** LCD screen—This displays user-configurable TripSaver II recloser status automatically, giving visibility for any crew member (no laptop needed).
- G** Internal communications—This allows the user to interact with the TripSaver II recloser wirelessly to handle programming and interrogation sessions from the base of the pole, without removing the unit from the cutout mounting.

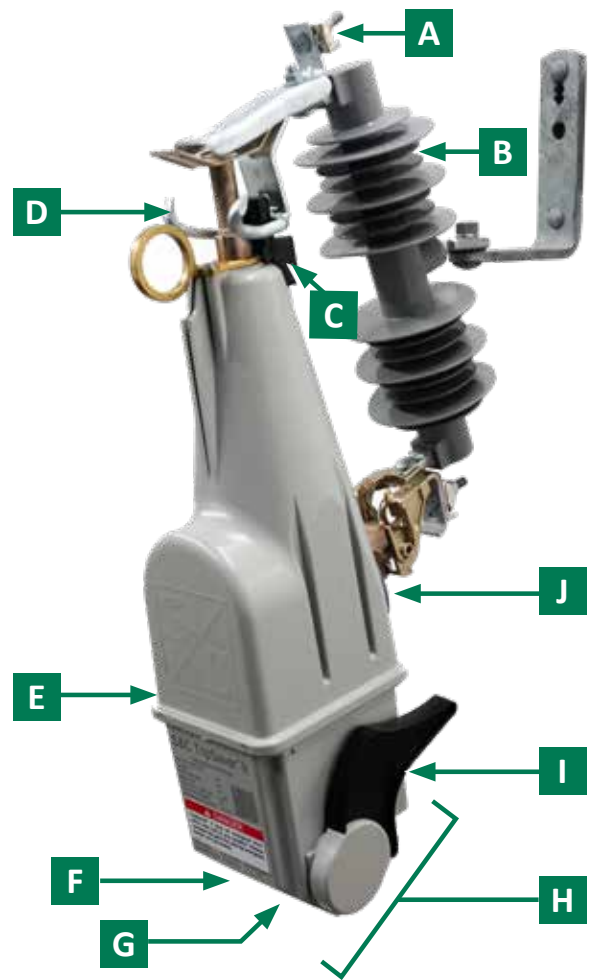

- H** MODE-SELECTOR lever—This allows crews working downstream of the TripSaver II recloser to select an automatic reclosing or nonreclosing operation.
- I** Tag-clip option—This allows crews to tag the TripSaver II recloser in a highly visible location, required to communicate nonstandard conditions.
- J** Trunnion—High-strength cast bronze, silver-plated (Surfaces around the trunnion bear on broad hinge surfaces to keep the TripSaver II recloser in alignment during closing. Its special shape facilitates easy removal and reduces vibration.)

# Application

---

## THE TRIPSAVER II RECLOSER'S FEATURES ARE:

### Remote Drop Open

When configured with a TripSaver® II Communications Gateway, the new **Remote Drop Open** feature will allow a **Drop Open** SCADA command to be sent via DNP 3.0 through the communications gateway to the TripSaver II recloser.

### Sequence Coordination

The **Sequence Coordination** feature maintains proper coordination between the TripSaver II Cutout-Mounted Recloser and downstream reclosers. If a fault is cleared by a downstream recloser, the TripSaver II recloser will shift to a user-configured (usually slower) TCC curve before fault-testing. The TripSaver II recloser will maintain its sequence coordination setting until the **Coordination Reset** timer expires.

### Sectionalizing Feature

The TripSaver II recloser features a **Sectionalizing** mode in both 4-kA and 6.3-kA rated models. When enabled, the recloser will operate as a sectionalizer over a user-specified range of fault currents when the source-side circuit breaker or recloser trips faster than the TripSaver II recloser does. It counts the number of operations of the source-side circuit breaker or recloser and drops open after a user-specified number of counts.

### Inrush-Restraint Feature

The TripSaver II Cutout-Mounted Recloser has a novel **Magnetizing Inrush-Restraint** feature that is always on, measuring second-harmonic current to distinguish fault current from inrush current. If inrush current is detected, the TripSaver II recloser will not trip. The **Inrush-Restraint** feature facilitates lower minimum pickup currents down to 5 amperes.

### Local Manual Open Feature

The **Local Manual Open** feature removes the requirement to use the Loadbuster tool for loadbreaking by providing a manual operation sequence that commands the TripSaver II recloser to open the vacuum-interrupter contacts and drop open.

## Non-Reclose TCC Curves


In earlier firmware versions, when the TripSaver II recloser NON-RECLOSE lever was in the **Down** (activated) position, the instantaneous TCC curve was automatically activated. The new **Non-Reclose** feature allows the user to configure three TCC curves from the library for use during **Non-Reclose** mode. These new TCC curves are named the Standard Non-Reclose TCC curve, the Post Fault Non-Reclose TCC curve, and the Cold Wake-up Non-Reclose TCC curve.

The curve that will be active is dependent on the load or fault condition prior to **Non-Reclose** mode activation or when a dropout previously occurred. The TCC curve selection will occur automatically without requiring the operator to manually select the appropriate settings. **Non-Reclose** (NR) mode can also be set remotely (**Remote Non-Reclose** [R-NR] mode) by a DNP 3.0 command when the TripSaver II recloser is properly configured with the gateway and transceiver.

## Gang Operation Feature

When multiple TripSaver II reclosers are properly configured together with the TripSaver II Communications Gateway, the **Gang Operation** feature allows any TripSaver II recloser that responds to a protection drop-open event or to a Local Manual Open drop-open event to signal the gateway to send **Drop-open** commands to the other configured TripSaver II reclosers. See Figure 5.

**FIGURE 5.** TripSaver II Communications Gateway Gang Operation feature

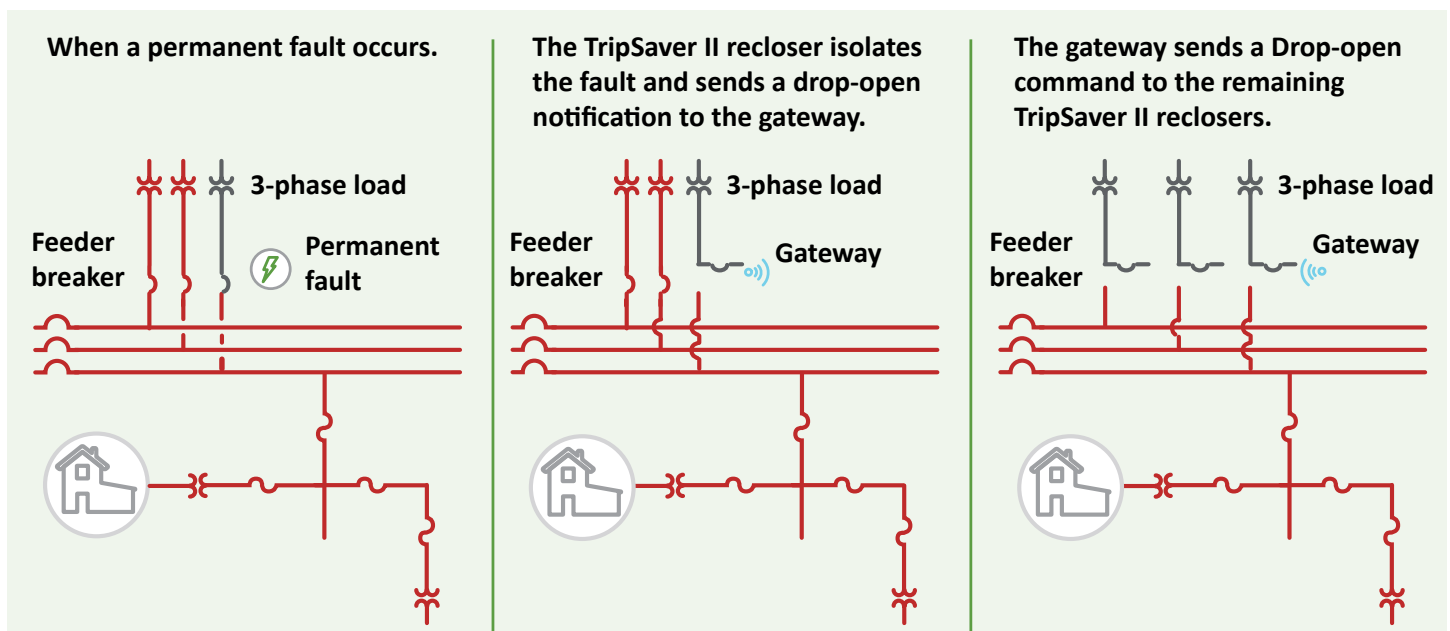

# Application

## TRIPSAVER® II COMMUNICATIONS VIA GATEWAY

The TripSaver II Cutout-Mounted Recloser offers a **Remote Communication** option using field-area networks already built for SCADA, advanced metering infrastructure, or distribution automation. See Figure 6. The remote communication provides the following data as DNP 3.0 functionality:

- ◆ Unsolicited alerts
- ◆ GPS time and coordinates
- ◆ Device heartbeat
- ◆ Remote mode-change capability

TripSaver II reclosers with the **Extended Open-Interval** feature and a communications gateway are required.

The communications gateway is a padlockable, weatherproof enclosure mounted directly on a utility pole. It includes a configurable gateway controller and provision for a radio of the customer's choice connected via an Ethernet or a serial port. The gateway uses control power from an overhead transformer and includes an optional backup battery for riding through a loss of control power to the communications gateway.

All gateway configurations include a door alarm system and an integrated multi-band antenna capable of supporting GPS, cellular radios, and 900-MHz ISM and 900-MHz MAS radios.

FIGURE 6. TripSaver II Communications Gateway





## TRIPSAVER® II SERVICE CENTER CONFIGURATION SOFTWARE


The TripSaver II recloser provides customers with flexibility to reconfigure their reclosers and read event logs using TripSaver II Service Center Configuration Software. The most recent release includes TripSaver II Service Center Configuration Software version 2.1 and the USB transceiver version 2.0. The combination of the new transceiver and software is fully backward-compatible with all previous versions of TripSaver II reclosers and snapshot files and should be used instead of any previous versions.

## SERVICE CENTER CONFIGURATION KIT

The portable configuration kit includes a universal power supply for the TripSaver II recloser and a USB transceiver for a computer to communicate with the recloser. See Figure 7.

The intuitive graphical user interface makes the configuration process quick and easy. The software also allows users to view status-related information, read event logs, and perform functional tests.

FIGURE 7. The service center configuration kit

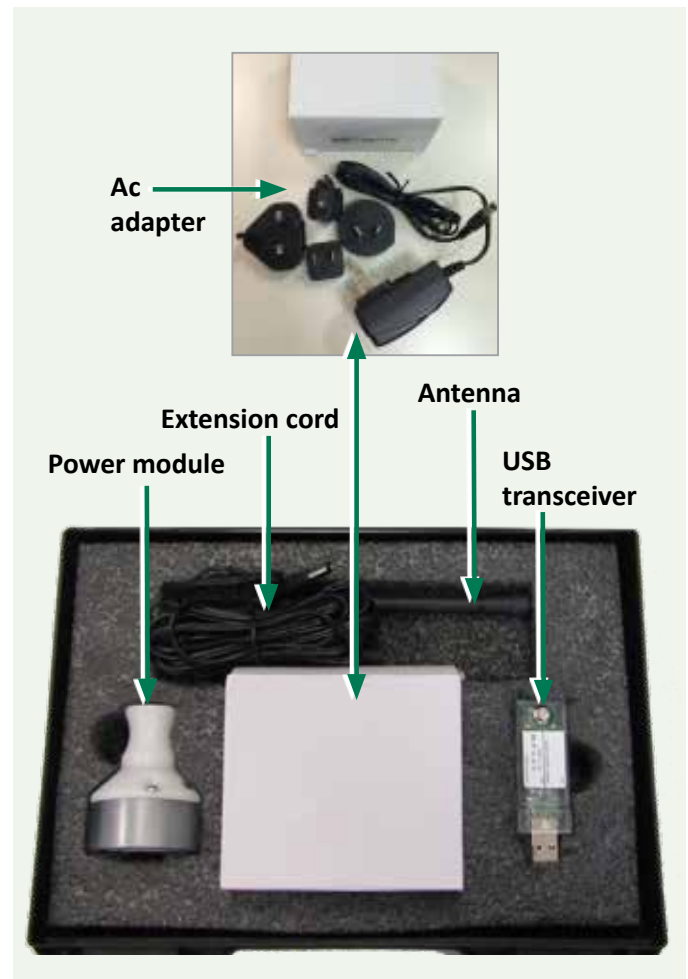

# Application

**TABLE 1.** Complete Overhead—Pole-Top Style TripSaver II Cutout-Mounted Recloser— For a new installation. Includes TripSaver II recloser, cutout mounting (less mounting bracket), and connectors

50/60-Hz Ratings <sup>[1]</sup> System Class, kV	50/60-Hz Ratings <sup>[1]</sup> Nom., kV	50/60-Hz Ratings <sup>[1]</sup> Max, kV	50/60-Hz Ratings <sup>[1]</sup> BIL, kV	50/60-Hz Ratings <sup>[1]</sup> Cont. Amperes, RMS <sup>[2]</sup>	50/60-Hz Ratings <sup>[1]</sup> Interr., Sym. Amperes, RMS <sup>[2]</sup>	With Porcelain Insulator Leakage Distance to Ground Minimum, Inches (mm)	With Polymer Insulator Leakage Distance to Ground Minimum, Inches (mm)
15	15	15.5	110	40	4 000	8½ (216)	14¾ (375)
15	15	15.5	110	40	6 300	8½ (216)	14¾ (375)
15	15	15.5	110	100	4 000	8½ (216)	14¾ (375)
15	15	15.5	110	100	6 300	8½ (216)	14¾ (375)
15	15	15.5	110	200	4 000	8½ (216)	14¾ (375)
15	15	15.5	110	200	6 300	8½ (216)	14¾ (375)
25	25	29	125	40	4 000	11 (279)	NA
25	25	29	125	40	6 300	11 (279)	NA
25	25	29	150	40	4 000	17 (432)	26½ (673)
25	25	29	150	40	6 300	17 (432)	26½ (673)
25	25	29	125	100	4 000	11 (279)	NA
25	25	29	125	100	6 300	11 (279)	NA
25	25	29	150	100	4 000	17 (432)	26½ (673)
25	25	29	150	100	6 300	17 (432)	26½ (673)
25	25	29	125	200	4 000	11 (279)	NA
25	25	29	125	200	6 300	11 (279)	NA
25	25	29	150	200	4 000	17 (432)	26½ (673)
25	25	29	150	200	6 300	17 (432)	26½ (673)

[1] For 50-Hz applications, specify the microprocessor control for application on 50-Hz systems, catalog number suffix “-F.”

[2] Minimum trip is 5 A for 40-A and 100-A TripSaver II reclosers; the minimum trip is 10 A for 200-A TripSaver II reclosers.

NA Not applicable



**CONTACT YOUR S&C SALES REPRESENTATIVE FOR MORE INFORMATION**

[sandc.com](http://sandc.com)

