

**Sealed SF<sub>6</sub> Interrupters**  
 Circuit-making and circuit-breaking are accomplished internally with no exposed moving parts or arcing contacts. See Figure 1.

**Internal Operation**  
 Full live-switching performance is ensured under any ice conditions because circuit-making and circuit-breaking are accomplished internally; there are no external moving parts.

**Integral Stored-Energy Operating Mechanism**  
 Charges with battery power, and it operates by solenoid control to open or close the SF<sub>6</sub> interrupting mechanism.

**Manual Operation Pull-Ring**  
 The operating mechanism has a manual-operation pull-ring, which permits non-electrical mechanical closing and opening of the interrupters in the event of a power loss. See Figure 1.

**Optional Visible Air-Gap Isolation of Switched-Open Circuits**  
 The integral single-pole, hookstick-operated disconnects provide a visible air-gap in the **Open** position. The disconnects are mechanically interlocked to prevent opening when the interrupters are closed and closing the interrupters when the disconnect is open. See Figure 2.

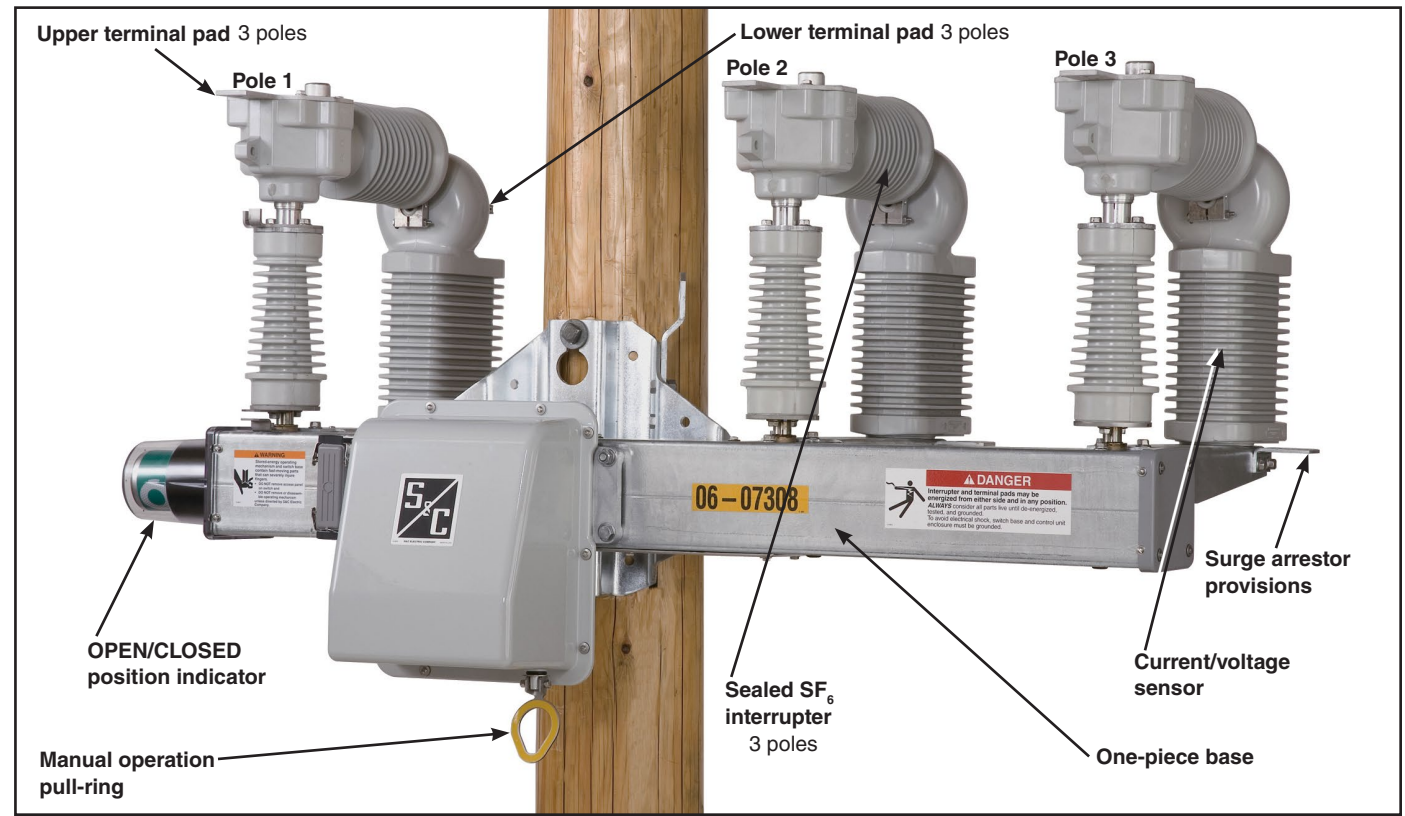


Figure 1. The Scada-Mate CX Switching System upright mounting configuration.

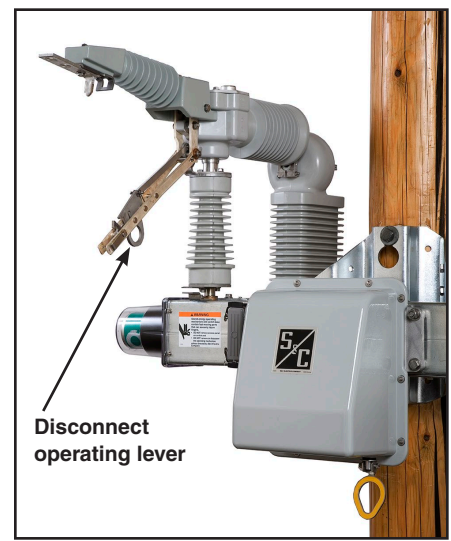


Figure 2. Front view of one pole with visible disconnect.

**Sensor Options**  
 The standard configuration includes a bus bar when no current or voltage sensing is required. Scada-Mate CX system can be optionally equipped with three-phase current sensors or three-phase current and voltage sensors. See Figure 1.

**Control Power**  
 The voltage sensor provides continuous battery-charging power for operating the complete automated-distribution switch installation.

**OPEN/CLOSED Indicator**  
**Green:** Interrupter open—"O"  
**Red:** Interrupter closed—"I"  
 Colors are reversed for option "-F2."  
 One indicator on the left is standard. Optionally, right-side only indicators or indicators on both sides are available. See Figure 1.

**One-Piece Base**  
 The base encloses high-speed drive linkages for the interrupters.

**Surge Arrestors**  
 Provision for mounting three surge arresters is standard. Provision for six surge arrestors is option "-A1." See Figure 1.

**Dead Ending**  
 Provisions for dead-ending are available and allow convenient attachment of conductors.

**⚠ WARNING**


Scada-Mate CX Switching Systems must be installed, operated, and maintained by qualified persons knowledgeable in overhead electric power distribution equipment and the associated hazards. This guide is not a replacement for adequate training and experience in safety procedures for this type of equipment. Read S&C Instruction Sheet 768-500 thoroughly and carefully before installing and operating the Scada-Mate CX Switching System.

★ Product discontinued.

**Enabling IntelliLink Setup Software Commands**

The 6801 control can be operated from the IntelliLink Setup Software *Operations* screen either locally or remotely. The connection is local when connected to the faceplate serial port and remote when connected by Ethernet or radio. To enable IntelliLink software remote commands, the **Remote Commands** setting must be enabled on the IntelliLink software *Setup>Security* screen.

Figure 3. The IntelliLink® Setup Software *Operation* screen.

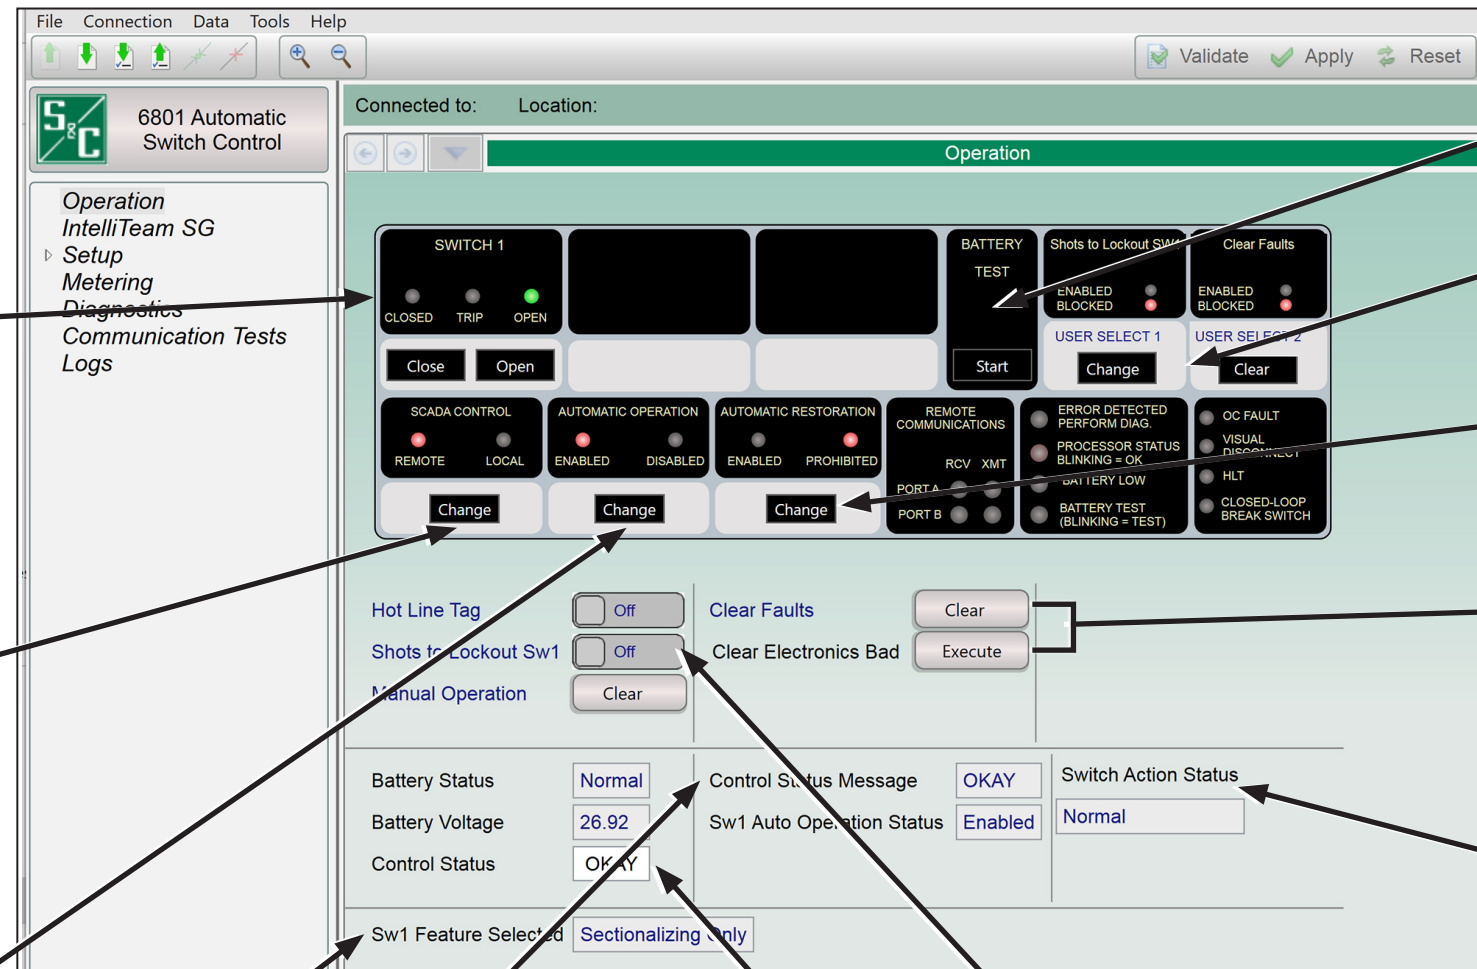

**SWITCH POSITION Indicator**

Switches can be manually operated from this screen. Click on the OPEN button to open the switch, and click on the CLOSE button to close the switch.

The switch position is indicated by switch contact information:

**Closed**—The switch contacts indicate a **Closed** switch position.

**Trip**—This indicates the switch was opened automatically, and it will turn off when the switch is in the **Closed** position.

**Open**—The switch contacts indicate an **Open** switch position. See Figure 2 on page 1.

**SCADA Control**

The CHANGE button sets the SCADA CONTROL indicator to the **Remote** or **Local** mode, as indicated by the LEDs:

**Remote**—This indicates SCADA commands are permitted.

**Local**—This indicates SCADA commands are blocked.

**Note:** The LOCAL button is only accessible when connected locally to the control.

**Automatic Operation**

The CHANGE button enables or disables **Automatic** operation, as indicated by the LEDs.

The **Automatic** operations are:

- Sectionalizing
- Phase-imbalance protection
- Phase-imbalance protection with automatic reclose
- One- or two-shot lockout of a faulted circuit

**Sw1 Feature Selected**

The **Automatic Operation** setting is configured on the *Setup>General>Automatic Op.* screen, and the configured setting is indicated here.

**Control Status Message**

“OKAY” indicates the control is operating correctly.

“Settings Mismatch” indicates the **Validate/Apply** command failed.

“Problem Present” indicates an error is detected that is not a **Warning** or **Alarm** condition.

**Sw1 6801 Control Auto Operation Status**

“Disabled” if the **Automatic Operation** function was disabled on the *Operation* screen or the faceplate.

“Enabled” if the **Automatic Operation** function was configured by SCADA.

**Battery Test**

The START button manually starts the battery test.

**User Select Commands**

The CHANGE button changes the status of the two **User Select** commands configured on the *Setup>General> User Commands* screen.

**Automatic Restoration**

The CHANGE button enables or disables the **Automatic Restoration** feature, as indicated by the LEDs, which should blink during testing.

**Clear Faults**

The CLEAR button clears all fault indicators.

**Clear Electronics Bad**

The EXECUTE button clears all bad electronics indicators.

**Switch Action Status**

This field indicates the status of SW1 if an active user-defined input has resulted in the switch action being blocked. The following statuses will be displayed in this field:

- “Sw1 Close Op Blocked”
- “Sw1 Open Op Blocked”
- “Normal”

Statuses only go active when the **User-Defined Input** feature is also set to block operation (block close or block both open and close) and they go active. The statuses clear when the **User-Defined Input** status points go inactive.

**Shots to Lockout Sw1/Sw2**

This button enables the **Shots to Lockout** mode. This feature is the configured number of three-phase voltage losses that must be detected during the configured **Shots to Lockout Time Threshold** setting before the control can trip open the switch.

**Manual Operation**

The CLEAR button clears a manual operation to return the IntelliTeam® Automatic Restoration System to a **Ready** state.

**Battery Status**

This is the overall status of the battery system. A battery system can be in a **Normal, Low, or Bad** state.

**Battery Voltage**

This shows the battery voltage under normal operating load.

**Control Status**

This can show the **OKAY, Warning, Alarm, or Maintenance Mode** status.